



NEMO|etc.

Certificate of Authorization #32455
353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

TEST

CONSULT

P.E. EVALUATION REPORT (PEER)

Tarco Roofing

One Information Way, Suite 225
Little Rock, AR 72202
(254) 913-7750

PEER-TAR-001.A.R21

FL10450-R20 (NON-HVHZ)

Date of Issuance: 07/11/2008

Revision 21: 02/23/2024

SCOPE:

This P.E. Evaluation Report (henceforth 'PEER') is issued under **F.A.C. Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The products described herein have been evaluated for compliance with the **8th Edition (2023) Florida Building Code sections noted herein.**

DESCRIPTION: Tarco Roof Underlayments (NON-HVHZ)

LABELING: Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein and **FBC 1507.1.1.**


CONTINUED COMPLIANCE: This PEER is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our PEERs by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO ETC, LLC requires a complete review of its PEER relative to updated Code requirements with each Code Cycle.

ADVERTISEMENT: The Florida Product Approval Number (FL#) preceded by the words "Nemo P.E. Evaluated" may be displayed in advertising literature. If any portion of the PEER is displayed, then it shall be done in its entirety.

INSPECTION: Upon request, a copy of this entire PEER shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This PEER consists of pages 1 through 12.

Prepared by:

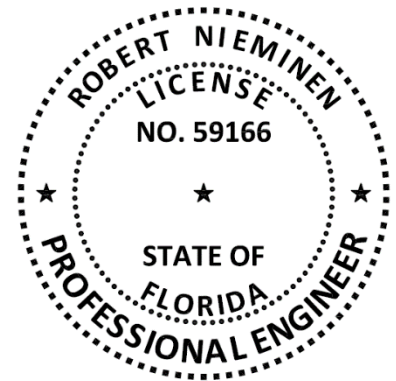

CERTIFICATION OF INDEPENDENCE:

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the PEERs are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

ROOFING COMPONENT EVALUATION:
1. SCOPE:

Product Category: Roofing
Sub-Category: Underlayment
Product Approval Method: Method 1, Option D – Codified Material, Evaluation by Engineer
Compliance Statement: Tarco Roof Underlayments, as produced by Tarco Roofing, have demonstrated compliance with the following sections of the **8th Edition (2023) Florida Building Code** through testing in accordance with the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

2. STANDARDS:

SECTION	PROPERTY	STANDARD
1504.2.1.4	Wind resistance	FM 4474
1504.2.1.4	Wind resistance	UL 1897
1507.1.1 / R905.1.1	Material standard	ASTM D226
1507.1.1 / R905.1.1	Material standard	ASTM D8257
1507.1.1, 1507.2.9.2 / R905.1.1, R905.2.8.2	Material standard	ASTM D1970
1507.2.9.2 / R905.2.8.2	Material standard	ASTM D3909
1507.2.9.2 / R905.2.8.2	Material standard	ASTM D6380
1507.3.3 / R905.3.3	Material standard	FRSA/TRI Manual
1515.2.4	Impact Resistance	ASTM D3746
TAS 110	Accelerated Weathering	ASTM D4798
TAS 110	Material standard	TAS 103

3. REFERENCES:

ENTITY	EXAMINATION	REFERENCE	DATE	ENTITY	EXAMINATION	REFERENCE	DATE
ERD (TST6049)	FM 4474	T6460.06.07-R2	06/26/07	NEMO (TST6049)	TA/LTA, TAS 103	4j-TAR-23-SSUDL-01	01/25/23
ERD (TST6049)	FM 4474	T37610.07.11	06/29/11	NEMO (TST6049)	TAS 103 (Tile Slip)	4j-TAR-23-SSUDL-03.A	03/13/23
ERD (TST6049)	FM 4474	TAR-SC5670.03.16	03/21/16	NEMO (TST6049)	UL1897	4a-TAR-23-LSWUS-01.A	05/10/23
ERD (TST6049)	ASTM D226	TAR-SC13965.02.17-R1	02/27/17	NEMO (TST6049)	ASTM D1970	4j-TAR-21-SSUDL-04.B	05/24/23
NEMO (TST6049)	FRSA/TRI	TAR-SC8020.06.18	06/05/18	NEMO (TST6049)	ASTM D8257	4j-TAR-23-SSUDL-02.A	06/07/23
NEMO (TST6049)	ASTM D4798	4j-TAR-19-SSUDL-01.A	08/27/19	NEMO (TST6049)	TA/LTA, TAS 103	4j-TAR-23-SSUDL-01.A	06/14/23
NEMO (TST6049)	ASTM D1970	4j-TAR-20-SSUDL-02.A	03/29/21	NEMO (TST6049)	TA/LTA, TAS 103	4j-TAR-23-SSUDL-04.A	10/06/23
NEMO (TST6049)	ASTM D1623/D4798	4j-TAR-20-SSUDL-03.A	05/04/21	NEMO (TST6049)	Extend Weathering	4j-TAR-23-SSUDL-05.A	11/16/23
NEMO (TST6049)	ASTM D3909	4j-TAR-21-SSUDL-01.A	10/01/21	NEMO (TST6049)	ASTM D4798	4j-TAR-23-SSUDL-10.A	11/27/23
NEMO (TST6049)	TAS 103	4j-TAR-21-SSUDL-01.C	11/05/21	NEMO (TST6049)	ASTM D1970	4j-TAR-23-SSUDL-07.A	11/28/23
NEMO (TST6049)	ASTM D226, Type II	4j-TAR-21-SSUDL-01.B	12/21/21	NEMO (TST6049)	UL1897	4j-TAR-23-LSWUS-03.A	12/20/23
NEMO (TST6049)	TA/LTA, TAS 103	4j-TAR-21-SSUDL-03.A	06/02/22	NEMO (TST6049)	UL1897	4j-TAR-23-LSWUS-02.A	01/03/24
NEMO (TST6049)	ASTM D6380	4j-TAR-22-SSUDL-01.A	07/25/22	NEMO	Traceability	FBC Cross-List	01/20/20
NEMO (TST6049)	ASTM D4798/D1623	4j-TAR-22-SSUDL-03.A	11/15/22	NEMO	Traceability	FBC Cross-List 2	03/22/21
NEMO (TST6049)	ASTM D1970	4j-TAR-21-SSUDL-04.A	10/14/22	UL (QUA9625)	QA	Service Confirm (INDIA)	11/22/16
NEMO (TST6049)	FM 4474	4a-TAR-22-LSWUS-01.A	12/12/22	UL (QUA9625)	QA	Service Confirm (PA & TX)	06/16/22
				UL (QUA9625)	QA	Florida BCIS	Current

4. PRODUCT DESCRIPTION:

TABLE 1: EVALUATED UNDERLAYMENTS			
PRODUCT	MATERIAL STANDARD	PLANT(S)	DESCRIPTION
#30 ASTM Specification Felt	ASTM D226, Type II	Greencastle, PA	asphalt-saturated organic felt
LeakBarrier® EasyLay®	ASTM D226, Type II	Belton, TX	asphalt-coated polyester fabric roof underlayment
LeakBarrier® EasyLay® UDL 15	ASTM D8257	Gujarat, India	woven-polymeric scrim with a textured fabric on the top surface
SRS Distribution TopShield® EL30	ASTM D8257	Gujarat, India	woven-polymeric scrim with a textured fabric on the top surface
LeakBarrier® EasyLay® UDL Basic	ASTM D8257	Gujarat, India	woven-polymeric scrim with a textured fabric on the top surface
LeakBarrier® FS500 ^{HT}	ASTM D1970	Belton, TX	self-adhering, film-surfaced, SBS modified roof underlayment
LeakBarrier® MS300 Ice and Water Armor	ASTM D1970	Belton, TX Greencastle, PA	self-adhering, glass mat reinforced, mineral surfaced, SBS modified roof underlayment
SRS Distribution TopShield Ice & Water G300	ASTM D1970	Belton, TX Greencastle, PA	self-adhering, glass mat reinforced, mineral surfaced, SBS modified roof underlayment
LeakBarrier® PS200 ^{HT} Ice and Water Armor	ASTM D1970, FRSA/TRI and TAS 103	Greencastle, PA	self-adhering, glass mat reinforced, fabric surfaced, SBS modified roof underlayment
LeakBarrier® PS200 ^{MU} Ice and Water Armor	ASTM D1970	Greencastle, PA	self-adhering, glass mat reinforced, smooth poly film surfaced, SBS modified roof underlayment
LeakBarrier® NR600 Ultra Ice and Water Armor	FRSA/TRI and TAS 103	Greencastle, PA	self-adhering, polyester-fabric surfaced, SBS modified roof underlayment
Fiberglass Mineral Surfaced Roll Roofing	ASTM D3909	Greencastle, PA	glass-fiber-reinforced, asphalt-coated, granule surfaced underlayment used as a valley liner
ASTM Organic Mineral Surface Tile Underlayment	ASTM D6380, Class M	Greencastle, PA	asphalt-saturated organic roll roofing sheet

5. LIMITATIONS:

- 5.1 This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance. PEERs are not to be construed as representing any attributes not specifically listed, nor are PEERs to be construed as an endorsement of the subject, or a recommendation for its use. There is no warranty by NEMO ETC, LLC or Robert Nieminen, P.E., express or implied, as to any finding or other matter in this PEER, or as to any product covered by the PEER.
- 5.2 This PEER is not for use in FBC High Velocity Hurricane Zone jurisdictions, as defined in FBC Chapter 2 (Broward and Miami-Dade Counties).
- 5.3 This PEER pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This PEER does not include evaluation of fire classification. Refer to **FBC 1505** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.

5.5 **Tarco Roof Underlayments** may be used with any prepared roof cover where the product is specifically referenced within FBC approval documents. If not listed, a request may be made to the Authority Having Jurisdiction for approval based on this PEER combined with supporting data for the prepared roof covering.

5.6 **Allowable Roof Covers:**

TABLE 2: ROOF COVER OPTIONS						
<u>FBC NON-HVHZ:</u>	1507.2	1507.3		1507.4 & 1507.5	1507.7	1507.8 & 1507.9
UNDERLAYMENT	ASPHALT SHINGLES	CLAY AND CONCRETE TILE		METAL PANELS OR SHINGLES	SLATE OR SLATE-TYPE SHINGLES	WOOD SHINGLES OR SHAKES
		MECHANICAL ATTACH	ADHESIVE- OR MORTAR-SET			
#30 ASTM Specification Felt	Yes	No	No	Yes	Yes	Yes
LeakBarrier EasyLay	Yes	Yes (Base Sheet per Table 4B)	Yes (Base Sheet per Table 4B)	No	Yes	No
LeakBarrier EasyLay UDL 15 or LeakBarrier EasyLay UDL Basic	Yes	Yes (Base Sheet per Table 4B)	Yes (Base Sheet per Table 4B)	Yes	Yes	No
TopShield EL30	Yes	Yes (Base Sheet per Table 4B)	Yes (Base Sheet per Table 4B)	Yes	Yes	No
LeakBarrier FS500 ^{HT}	Yes	No	No	Yes	Yes	Yes ¹
LeakBarrier MS300	Yes	No	No	No	Yes	Yes ¹
TopShield Ice & Water G300	Yes	No	No	No	Yes	Yes ¹
LeakBarrier PS200 ^{HT}	Yes	Yes	Yes (Table 2A)	Yes (No copper or zinc)	Yes	Yes ¹
LeakBarrier PS200 ^{MU}	Yes	No	No	Yes (No copper or zinc)	Yes	Yes ¹
LeakBarrier NR600 Ultra	Yes	Yes	Yes (Table 2A)	Yes (No copper or zinc)	Yes	Yes ¹
Fiberglass Mineral Surfaced Roll Roofing	Yes (Valley Liner)	No	No	No	No	No
ASTM Organic Mineral Surface Tile Underlayment	Yes (Valley Liner)	No	No	No	No	No

5.6.1 **Allowable Tile Adhesives:**

TABLE 2A: ALLOWABLE UNDERLAYMENT / TILE-ADHESIVE COMBINATIONS ²						
UNDERLAYMENT	TILE-ADHESIVE OPTIONS AND FLORIDA PRODUCT APPROVAL					
	DAP GLOBAL		DUPONT	ICP CONSTRUCTION		MORTAR (MEETING FRSA/TRI AND HOLDING CURRENT FPA)
	FL14506		FL22525	FL6332	FL6276	
	STORMBOND	STORMBOND 2	TILE BOND	APOC POLYSET AH-160	APOC POLYSET RTA-1	
LeakBarrier NR600 Ultra	Yes	Yes	Yes	Yes	Yes	No
LeakBarrier PS200 ^{HT}	No	No	Yes	Yes	Yes	No

¹ Used as min. 3 ¾-inch wide joint-strips per FBC 1507.1.1.1(2) / FBC R905.1.1.1(2) or installed in full-coverage atop ASTM D226, Type II felt, ASTM D4869 Type III or IV felt, LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic mechanically attached in accordance with FBC Table 1507.1.1.1 or FBC Residential Table R905.1.1.1.

² Refer to Tile Manufacturer's or Adhesive Manufacturer's Florida Product Approval for Overturning Moment Resistance Performance.

5.7 **Allowable Substrates:**

TABLE 3: ALLOWABLE SUBSTRATE OPTIONS FOR ADHERED UNDERLAYMENTS				
UNDERLAYMENT	APPLICATION	SUBSTRATES (DESIGNED TO MEET CODE)		
		TYPE	PRIMER	MATERIAL(S)
LeakBarrier FS500 ^{HT}	self-adhering	Deck / sheathing	(Optional) ASTM D41	Plywood, OSB
		Base Sheet	None	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic
		Flashing / Valley	ASTM D41	aluminum, galvanized steel
LeakBarrier MS300, TopShield Ice & Water G300, LeakBarrier PS200 ^{HT} , LeakBarrier PS200 ^{MU} or LeakBarrier NR600 Ultra	self-adhering	Deck / sheathing	(Optional) ASTM D41	Plywood, OSB
		Deck	ASTM D41	structural concrete
		Base Sheet	None	ASTM D226 Type II felt; ASTM D4869 Type III or IV felt; LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic
		Flashing / Valley	ASTM D41	aluminum, galvanized steel
ASTM Organic Mineral Surface Tile Underlayment	hot asphalt	Deck	ASTM D41	structural concrete
		Base Sheet	None	ASTM D226 Type II felt, ASTM D4601 base sheet

5.8 **Attachment Limitations:**

5.8.1 For use under mechanically attached NON-TILE prepared roof coverings, attachment shall be in accordance with the manufacturer’s installation instructions, but – for mechanically attached underlayments or base sheets - not less than **FBC 1507.1.1** or **R905.1.1**.

5.8.2 Wind Resistance for Underlayment Systems in Tile Roof Applications:

The following wind uplift limitations apply to tile underlayment systems. The Maximum Design Pressure (‘MDP’) is the result of testing for wind load resistance based on allowable wind loads, and reflects the ultimate passing pressure divided by 2 (the 2 to 1 margin of safety per **FBC 1504.9** has already been applied).

5.8.2.1 Direct-to-Deck:

The maximum design pressure for the selected assembly shall meet or exceed that required under **FRSA/TRI Florida Manual, 7th Edition, Appendix A** or the critical (highest) design pressure determined in accordance with **FBC 1609** or **FBC Residential Chapter 3**.

TABLE 4A: ALLOWABLE DESIGN PRESSURES, ADHERED, DIRECT-TO-DECK UNDERLAYMENT SYSTEMS						
SYSTEM No.	DECK	PRIMER	JOINT TREATMENT	BASE PLY	CAP PLY	MDP (PSF)
UDL-1.	OSB, APA rated sheathing, 32/16, Exposure 1, PS2, 15/32 category	ASTM D41	None	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back-nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-60.0
UDL-2.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) ASTM D41	None	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} or LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-75.0

**TABLE 4A: ALLOWABLE DESIGN PRESSURES,
ADHERED, DIRECT-TO-DECK UNDERLAYMENT SYSTEMS**

SYSTEM NO.	DECK	PRIMER	JOINT TREATMENT	BASE PLY	CAP PLY	MDP (PSF)
UDL-3.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) ASTM D41	None	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-82.5
UDL-4.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) ASTM D41	None	None	LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-105.0
UDL-5.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) ASTM D41	Min. 4-inch wide strips of LeakBarrier PS200 ^{MU}	None	LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-120.0
UDL-6.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) ASTM D41	Min. 4-inch wide strips of LeakBarrier PS200 ^{MU} or LeakBarrier EasyBase	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-120.0
UDL-7.	Nominal 1-inch, SYP, T&G wood plank	(Optional) ASTM D41	None	None	LeakBarrier NR600 Ultra, self-adhered and back-nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-135.0
UDL-8.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	ASTM D41	None	None	LeakBarrier NR600 Ultra, self-adhered and back-nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps, max. 12-inch o.c.	-142.5
UDL-9.	Structural concrete	(Optional) ASTM D41	N/A	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} or LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-217.5
UDL-10.	Structural concrete	ASTM D41	N/A	None	LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-340.0

5.8.2.2 Mechanically-Attached Base Sheet:

The maximum design pressure for the selected assembly shall meet or exceed that required under **FRSA/TRI Manual 7th Edition, Appendix A** or the critical (highest) design pressure determined in accordance with **FBC 1609** or **FBC Residential Chapter 3**.

Alternatively, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 design pressure determined in accordance with **FBC 1609** or **FBC Residential Chapter 3**. Elevated pressure zones shall employ an attachment density by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI](#) WD1, [FM Loss Prevention Data Sheet](#) 1-29 or [Roofing Application Standard](#) RAS 117 or RAS 137. Assemblies marked with an asterisk* carry the limitations set forth in Section 2.2.10.1 of [FM Loss Prevention Data Sheet](#) 1-29 for enhancements.

TABLE 4B: ALLOWABLE DESIGN PRESSURES, MECHANICALLY ATTACHED, MULTI-PLY UNDERLAYMENT SYSTEMS						
SYSTEM NO.	DECK	BASE SHEET		BASE PLY	CAP PLY	MDP (PSF)
		TYPE	ATTACH			
UDL-11.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 8-inch o.c. at three (3) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-45.0*
UDL-12.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 8-inch o.c. at three (3) equally spaced, staggered center rows. ASTM D41 primer at tin caps.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-45.0*
UDL-13.	Plywood , APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	LeakBarrier EasyLay	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 7-inch o.c. at the 4-inch wide side laps and 7-inch o.c. at three (3) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-60.0
UDL-14.	Plywood , APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	LeakBarrier EasyLay	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 7-inch o.c. at the 4-inch wide side laps and 7-inch o.c. at three (3) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back-nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps spaced 12-inch o.c. within the self-adhering side laps	-60.0
UDL-15.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at four (4) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-60.0

TABLE 4B: ALLOWABLE DESIGN PRESSURES, MECHANICALLY ATTACHED, MULTI-PLY UNDERLAYMENT SYSTEMS						
SYSTEM No.	DECK	BASE SHEET		BASE PLY	CAP PLY	MDP (PSF)
		TYPE	ATTACH			
UDL-16.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at four (4) equally spaced, staggered center rows. ASTM D41 primer at tin caps.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps spaced 12-inch o.c. within the self-adhering side laps	-60.0
UDL-17.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 4-inch o.c. at the 4-inch wide side laps and 4-inch o.c. at four (4) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-120.0
UDL-18.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 4-inch o.c. at the 4-inch wide side laps and 4-inch o.c. at four (4) equally spaced, staggered center rows.	LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps spaced 12-inch o.c. within the self-adhering side laps	-120.0

5.9 **Exposure Limitations:**

TABLE 5: EXPOSURE LIMITATIONS		
UNDERLAYMENT	PREPARED ROOF COVER INSTALLATION TYPE	MAXIMUM EXPOSURE (DAYS)
#30 ASTM Specification Felt	Mechanically attached	1
LeakBarrier MS300, PS200 ^{MU} or TopShield Ice & Water G300	Mechanically attached	30
LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	Mechanically attached	90
LeakBarrier EasyLay, LeakBarrier FS500 ^{HT}	Mechanically attached	180
LeakBarrier PS200 ^{HT}	Any type (per Table 2)	180
ASTM Organic Mineral Surface Tile Underlayment	Any type (per Table 2)	180
LeakBarrier NR600 Ultra	Any type (per Table 2)	360

5.10 **Tile Slippage Limitations:** When loading roof tiles on the underlayment, the maximum roof pitch shall be as follows. These pitch limitations can only be exceeded by using battens or loading boards during loading of the roof tiles.

TABLE 6: TILE SLIPPAGE LIMITATIONS FOR DIRECT-DECK TILE INSTALLATIONS			
UNDERLAYMENT*	TILE PROFILE	STAGING METHOD	MAXIMUM STAGING PITCH
LeakBarrier PS200 ^{HT}	Flat or Lugged	6-tile stack (4 over 2)	6:12
LeakBarrier NR600 Ultra	Flat or Lugged	10-tile stack	6:12
2-ply system; LeakBarrier PS200 ^{MU} followed by LeakBarrier NR600 Ultra	Flat or Lugged	10-tile stack	6:12

Notes: *Tarco specifies a minimum 48 cure-time after the installation of self-adhering membranes and before loading of roofing tiles.

6. INSTALLATION:

- 6.1 **Tarco Roof Underlayments** shall be installed in accordance with **Tarco Roofing** installation instructions subject to the [Limitations of Use](#) herein and the specifics noted below.
- 6.1.1 Consult Tarco requirements for back-nailing at pitch of 2:12 or greater.
- 6.2 Re-fasten any loose decking panels, and check for protruding nail heads. Sweep the substrate thoroughly to remove any dust and debris prior to application, and prime the substrate (if applicable).
- 6.3 Refer to [Section 6.4](#) for underlayments having prescriptive codified minimum attachment or Tables [4A](#) and [4B](#) for underlayment systems having maximum design pressures established in accordance with FBC 1504.2.1.4.
- 6.4 **Underlayment Assemblies with Prescriptive Minimum Attachment for use in NON-TILE applications:**

6.4.1 CODE REFERENCE: 1507.1.1.1 or R905.1.1.1, Option 1: Underlayment adhered to deck

DECK DESCRIPTION: Code-minimum wood or structural concrete deck to the satisfaction of the Authority Having Jurisdiction (refer to [Table 3](#) for specific underlayment/substrate combinations)

UNDERLAYMENT: BASE PLY: (Optional) **LeakBarrier® PS200^{MU}** self-adhered in accordance with FBC Section 1507.1.1.1(1) or R905.1.1.1(1) and back-nailed in accordance with the manufacturer’s requirements.

CAP PLY: **LeakBarrier FS500^{HT}, LeakBarrier® MS300, LeakBarrier® PS200^{MU}, TopShield Ice & Water G300, LeakBarrier® PS200^{HT} or LeakBarrier® NR600 Ultra** self-adhered in accordance with FBC Section 1507.1.1.1(1) or R905.1.1.1(1) and back-nailed in accordance with the manufacturer’s requirements.

SURFACING: FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, subject to the allowable roof covers in [Table 2 herein](#).

6.4.2 CODE REFERENCE: 1507.1.1.1 or R905.1.1.1, Option 2: Self-adhering strips to deck-joints followed by underlayment mechanically attached to deck

DECK DESCRIPTION: Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction

SECONDARY WATER BARRIER: Min. 3 ¼-inch wide strips of **LeakBarrier FS500^{HT}, LeakBarrier® MS300, LeakBarrier® PS200^{MU}, TopShield Ice & Water G300, LeakBarrier® PS200^{HT} or LeakBarrier® NR600 Ultra** self-adhered over joints of the roof deck prior to installation of subsequent layer(s) in accordance with FBC Section 1507.1.1.1(2) or R905.1.1.1(2). Do not overlap end-joints or T-joints. All end-joints and T-joints shall be butted firmly side by side, flush with each other but not overlapped.

UNDERLAYMENT: **#30 ASTM Specification Felt** in accordance with FBC Table 1507.1.1.1 or Table R905.1.1.1, with a minimum 4-inch side lap and 6-inch end lap, mechanically fastened to deck

FASTENERS: Min. 0.083-inch diameter annular ring or deformed shank nails with metal or plastic caps* with a nominal cap diameter of not less than 1-inch and minimum thickness as follows.

Cap Type	Minimum thickness
Metal cap	32 ga. sheet metal
Power-driven metal cap	0.010-inch
Plastic cap	0.035-inch (outside edge thickness)

The nail shall be of sufficient length to penetrate through the roof sheathing, or not less than 0.75-inch into the roof sheathing.

*NOTE: Metal caps are required where the ultimate design wind speed, V_{ult} , equals or exceeds 170 mph.

FASTENING: Grid pattern of 12-inches between the overlaps and 6-inch spacing at the overlaps, in accordance with FBC Table 1507.1.1.1 or Table R905.1.1.1

SURFACING: FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, wood shakes or wood shingles, subject to the allowable roof covers in [Table 2 herein](#).

6.4.3	CODE REFERENCE: 1507.1.1.1 or R905.1.1.1, Option 2: Self-adhering strips to deck-joints followed by underlayment mechanically attached to deck								
DECK DESCRIPTION:	Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction								
SECONDARY WATER BARRIER:	Min. 3 ¼-inch wide strips of LeakBarrier FS500^{HT}, LeakBarrier® MS300, LeakBarrier® PS200^{MU}, TopShield Ice & Water G300, LeakBarrier® PS200^{HT} or LeakBarrier® NR600 Ultra self-adhered over joints of the roof deck prior to installation of subsequent layer(s) in accordance with FBC Section 1507.1.1.1(2) or R905.1.1.1(2). Do not overlap end-joints or T-joints. All end-joints and T-joints shall be butted firmly side by side, flush with each other but not overlapped.								
UNDERLAYMENT:	LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic in accordance with FBC Table 1507.1.1.1 or Table R905.1.1.1, with a minimum 4-inch side lap and 6-inch end lap, mechanically fastened to deck								
FASTENERS:	Min. 0.083-inch diameter annular ring or deformed shank nails with metal or plastic caps* with a nominal cap diameter of not less than 1-inch and minimum thickness as follows. <table border="0"> <thead> <tr> <th style="text-align: left;"><u>Cap Type</u></th> <th style="text-align: left;"><u>Minimum thickness</u></th> </tr> </thead> <tbody> <tr> <td>Metal cap</td> <td>32 ga. sheet metal</td> </tr> <tr> <td>Power-driven metal cap</td> <td>0.010-inch</td> </tr> <tr> <td>Plastic cap</td> <td>0.035-inch (outside edge thickness)</td> </tr> </tbody> </table> <p>The nail shall be of sufficient length to penetrate through the roof sheathing, or not less than 0.75-inch into the roof sheathing.</p>	<u>Cap Type</u>	<u>Minimum thickness</u>	Metal cap	32 ga. sheet metal	Power-driven metal cap	0.010-inch	Plastic cap	0.035-inch (outside edge thickness)
<u>Cap Type</u>	<u>Minimum thickness</u>								
Metal cap	32 ga. sheet metal								
Power-driven metal cap	0.010-inch								
Plastic cap	0.035-inch (outside edge thickness)								
	*NOTE: Metal caps are required where the ultimate design wind speed, V_{ult} , equals or exceeds 170 mph.								
FASTENING:	Grid pattern of 12-inches between the overlaps and 6-inch spacing at the overlaps, in accordance with FBC Table 1507.1.1.1 or Table R905.1.1.1								
SURFACING:	FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, subject to the allowable roof covers in Table 2 herein .								

6.4.4	CODE REFERENCE: 1507.1.1.1 or R905.1.1.1, Option 3: Two-layer underlayment mechanically fastened to deck						
DECK DESCRIPTION:	Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction						
UNDERLAYMENT:	Two (2) layers of #30 ASTM Specification Felt in accordance with FBC Section 1507.1.1.1(3) or R905.1.1.1(3).						
FASTENERS:	Min. 0.083-inch diameter annular ring or deformed shank nails with metal or plastic caps* with a nominal cap diameter of not less than 1-inch and minimum thickness as follows. <table border="0"> <thead> <tr> <th style="text-align: left;"><u>Cap Type</u></th> <th style="text-align: left;"><u>Minimum thickness</u></th> </tr> </thead> <tbody> <tr> <td>Metal cap</td> <td>32 ga. sheet metal</td> </tr> <tr> <td>Plastic cap</td> <td>0.035-inch (outside edge thickness)</td> </tr> </tbody> </table> <p>The nail shall be of sufficient length to penetrate through the roof sheathing, or not less than 0.75-inch into the roof sheathing.</p>	<u>Cap Type</u>	<u>Minimum thickness</u>	Metal cap	32 ga. sheet metal	Plastic cap	0.035-inch (outside edge thickness)
<u>Cap Type</u>	<u>Minimum thickness</u>						
Metal cap	32 ga. sheet metal						
Plastic cap	0.035-inch (outside edge thickness)						
	*NOTE: Metal caps are required where the ultimate design wind speed, V_{ult} , equals or exceeds 170 mph.						
FASTENING:	Grid pattern of 12-inches between the overlaps and 6-inch spacing at the overlaps, in accordance with FBC Section 1507.1.1.1(3) or R905.1.1.1(3).						
SURFACING:	FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, wood shakes or wood shingles, subject to the allowable roof covers in Table 2 herein .						

6.4.5	CODE REFERENCE: 1507.1.1.1 or R905.1.1.1, Option 3: Two-layer underlayment mechanically fastened to deck						
DECK DESCRIPTION:	Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction						
UNDERLAYMENT:	Two (2) layers of LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic in accordance with FBC Section 1507.1.1.1(3) or R905.1.1.1(3).						
FASTENERS:	Min. 0.083-inch diameter annular ring or deformed shank nails with metal or plastic caps* with a nominal cap diameter of not less than 1-inch and minimum thickness as follows. <table border="0"> <thead> <tr> <th style="text-decoration: underline;">Cap Type</th> <th style="text-decoration: underline;">Minimum thickness</th> </tr> </thead> <tbody> <tr> <td>Metal cap</td> <td>32 ga. sheet metal</td> </tr> <tr> <td>Plastic cap</td> <td>0.035-inch (outside edge thickness)</td> </tr> </tbody> </table> <p>The nail shall be of sufficient length to penetrate through the roof sheathing, or not less than 0.75-inch into the roof sheathing.</p>	Cap Type	Minimum thickness	Metal cap	32 ga. sheet metal	Plastic cap	0.035-inch (outside edge thickness)
Cap Type	Minimum thickness						
Metal cap	32 ga. sheet metal						
Plastic cap	0.035-inch (outside edge thickness)						
*NOTE:	Metal caps are required where the ultimate design wind speed, V_{ult} , equals or exceeds 170 mph.						
FASTENING:	Grid pattern of 12-inches between the overlaps and 6-inch spacing at the overlaps, in accordance with FBC Section 1507.1.1.1(3) or R905.1.1.1(3).						
SURFACING:	FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, subject to the allowable roof covers in Table 2 herein .						

6.4.6	CODE REFERENCE: 1507.1.1.1 or R905.1.1.1, Option 1 combined with Option 2 or 3: Optional self-adhering strips to deck-joints followed by base sheet mechanically fastened to deck followed by underlayment adhered to base sheet								
DECK DESCRIPTION:	Code-minimum wood deck to the satisfaction of the Authority Having Jurisdiction								
SECONDARY WATER BARRIER:	(Optional) Min. 3 ¾-inch wide strips of LeakBarrier FS500^{HT}, LeakBarrier[®] MS300, LeakBarrier[®] PS200^{MU}, TopShield Ice & Water G300, LeakBarrier[®] PS200^{HT} or LeakBarrier[®] NR600 Ultra self-adhered over joints of the roof deck prior to installation of subsequent layer(s) in accordance with FBC Section 1507.1.1.1(2) or R905.1.1.1(2). Do not overlap end-joints or T-joints. All end-joints and T-joints shall be butted firmly side by side, flush with each other but not overlapped.								
BASE SHEET:	One (1) layer of #30 ASTM Specification Felt, LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30, LeakBarrier EasyLay UDL Basic or FBC Approved ASTM D226, Type II felt, in accordance with FBC Table 1507.1.1.1 or Table R905.1.1.1, with a minimum 4-inch side lap and 6-inch end lap or two (2) layers of #30 ASTM Specification Felt, LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30, LeakBarrier EasyLay UDL Basic or FBC Approved ASTM D226, Type II felt in accordance with FBC Section 1507.1.1.1(3) or R905.1.1.1(3), mechanically fastened to deck								
FASTENERS:	Min. 0.083-inch diameter annular ring or deformed shank nails with metal or plastic caps* with a nominal cap diameter of not less than 1-inch and minimum thickness as follows. <table border="0"> <thead> <tr> <th style="text-decoration: underline;">Cap Type</th> <th style="text-decoration: underline;">Minimum thickness</th> </tr> </thead> <tbody> <tr> <td>Metal cap</td> <td>32 ga. sheet metal</td> </tr> <tr> <td>Power-driven metal cap</td> <td>0.010-inch</td> </tr> <tr> <td>Plastic cap</td> <td>0.035-inch (outside edge thickness)</td> </tr> </tbody> </table> <p>The nail shall be of sufficient length to penetrate through the roof sheathing, or not less than 0.75-inch into the roof sheathing.</p>	Cap Type	Minimum thickness	Metal cap	32 ga. sheet metal	Power-driven metal cap	0.010-inch	Plastic cap	0.035-inch (outside edge thickness)
Cap Type	Minimum thickness								
Metal cap	32 ga. sheet metal								
Power-driven metal cap	0.010-inch								
Plastic cap	0.035-inch (outside edge thickness)								
*NOTE:	Metal caps are required where the ultimate design wind speed, V_{ult} , equals or exceeds 170 mph.								
FASTENING:	Grid pattern of 12-inches between the overlaps and 6-inch spacing at the overlaps, in accordance with FBC Table 1507.1.1.1 or Table R905.1.1.1 or FBC Section 1507.1.1.1(3) or R905.1.1.1(3).								
UNDERLAYMENT:	BASE PLY: (Optional) LeakBarrier[®] PS200^{MU} self-adhering and back-nailed in accordance with the manufacturer's requirements. CAP PLY: LeakBarrier FS500^{HT}, LeakBarrier[®] MS300, LeakBarrier[®] PS200^{MU}, TopShield Ice & Water G300, LeakBarrier[®] PS200^{HT} or LeakBarrier[®] NR600 Ultra self-adhering and back-nailed in accordance with the manufacturer's requirements.								
SURFACING:	FBC Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles, subject to the allowable roof covers in Table 2 herein .								

6.5 ASTM Organic Mineral Surface Tile Underlayment or Fiberglass Mineral Surface Roll Roofing:

- 6.5.1 ASTM Organic Mineral Surface Tile Underlayment or Fiberglass Mineral Surface Roll Roofing may be used as a valley liner in accordance with **FBC 1507.2.9.2** or **FBC Residential R905.2.8.2**. Installation shall be in accordance with the manufacturer's instructions.

7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction in order to properly evaluate the installation of this product.

8. MANUFACTURING PLANTS:

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

9. QUALITY ASSURANCE ENTITY:

[UL LLC – QUA9625](#); (360) 817-5512; bsai.inspections@ul.com

- END OF PEER -

FBC NON-HVHZ