



NEMO|etc.

Certificate of Authorization #32455
353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

EVALUATE

TEST

CONSULT

P.E. EVALUATION REPORT (PEER)

Tarco Roofing

One Information Way, Suite 225
Little Rock, AR 72202
(254) 913-7750

PEER-TAR-001.A.R19

FL10450-R19 (NON-HVHZ)

Date of Issuance: 07/11/2008

Revision 19: 10/19/2023

SCOPE:

This P.E. Evaluation Report (henceforth 'PEER') is issued under **F.A.C. Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The products described herein have been evaluated for compliance with the **8th Edition (2023) Florida Building Code** [sections noted herein](#).

DESCRIPTION: Tarco Roof Underlayments (NON-HVHZ)

LABELING: Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein and [FBC 1507.1.1](#).

CONTINUED COMPLIANCE: This PEER is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our PEERs by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO ETC, LLC requires a complete review of its PEER relative to updated Code requirements with each Code Cycle.

ADVERTISEMENT: The Florida Product Approval Number (FL#) preceded by the words "NEMO P.E. Evaluated" may be displayed in advertising literature. If any portion of the PEER is displayed, then it shall be done in its entirety.


INSPECTION: Upon request, a copy of this entire PEER shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This PEER consists of pages 1 through 10.

Prepared by:

Digitally signed by
Robert Nieminen
Date: 2023.10.19
'11:25:04 -04'00

This item has been digitally signed and sealed by Robert Nieminen, P.E.
Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.
Robert Nieminen, Florida P.E. 59166, FBC ANE1983
NEMO ETC, LLC, Florida CA #32455

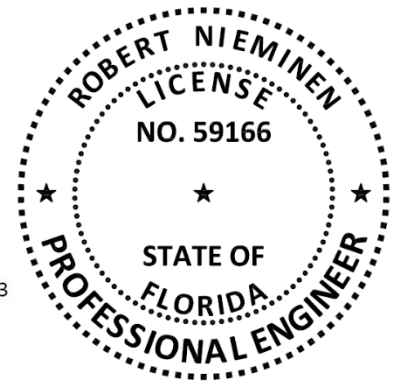

CERTIFICATION OF INDEPENDENCE:

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the PEERs are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

©2018, NEMO ETC, LLC

ROOFING COMPONENT EVALUATION:
1. SCOPE:
Product Category: Roofing

Sub-Category: Underlayment

Product Approval Method: Method 1, Option D – Codified Material, Evaluation by Engineer

Compliance Statement: Tarco Roof Underlayments, as produced by Tarco Roofing, have demonstrated compliance with the following sections of the **8th Edition (2023) Florida Building Code** through testing in accordance with the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

2. STANDARDS:

SECTION	PROPERTY	STANDARD
1504.2.1.4	Wind resistance	FM 4474
1504.2.1.4	Wind resistance	UL 1897
1507.1.1 / R905.1.1	Material standard	ASTM D226
1507.1.1 / R905.1.1	Material standard	ASTM D8257
1507.1.1, 1507.2.9.2 / R905.1.1, R905.2.8.2	Material standard	ASTM D1970
1507.2.9.2 / R905.2.8.2	Material standard	ASTM D3909
1507.2.9.2 / R905.2.8.2	Material standard	ASTM D6380
1507.3.3 / R905.3.3	Material standard	FRSA/TRI Manual
TAS 110	Accelerated Weathering	ASTM D4798
TAS 110	Material standard	TAS 103

3. REFERENCES:

ENTITY	EXAMINATION	REFERENCE	DATE	ENTITY	EXAMINATION	REFERENCE	DATE
ERD (TST6049)	FM 4474	T6460.06.07-R2	06/26/07	NEMO (TST6049)	ASTM D1970	4j-TAR-21-SSUDL-04.A	10/14/22
ERD (TST6049)	FM 4474	T37610.07.11	06/29/11	NEMO (TST6049)	FM 4474	4a-TAR-22-LSWUS-01.A	12/12/22
ERD (TST6049)	FM 4474	TAR-SC5670.03.16	03/21/16	NEMO (TST6049)	TA/LTA, TAS 103	4j-TAR-23-SSUDL-01	01/25/23
ERD (TST6049)	ASTM D226	TAR-SC13965.02.17-R1	02/27/17	NEMO (TST6049)	TAS 103 (Tile Slip)	4j-TAR-23-SSUDL-03.A	03/13/23
NEMO (TST6049)	FRSA/TRI	TAR-SC8020.06.18	06/05/18	NEMO (TST6049)	UL1897	4a-TAR-23-LSWUS-01.A	05/10/23
NEMO (TST6049)	ASTM D4798	4j-TAR-19-SSUDL-01.A	08/27/19	NEMO (TST6049)	ASTM D1970	4j-TAR-21-SSUDL-04.B	05/24/23
NEMO (TST6049)	ASTM D1970	4j-TAR-20-SSUDL-02.A	03/29/21	NEMO (TST6049)	ASTM D8257	4j-TAR-23-SSUDL-02.A	06/07/23
NEMO (TST6049)	ASTM D1623/D4798	4j-TAR-20-SSUDL-03.A	05/04/21	NEMO (TST6049)	TA/LTA, TAS 103	4j-TAR-23-SSUDL-01.A	06/14/23
NEMO (TST6049)	ASTM D3909	4j-TAR-21-SSUDL-01.A	10/01/21	NEMO (TST6049)	TA/LTA, TAS 103	4j-TAR-23-SSUDL-04.A	10/06/23
NEMO (TST6049)	TAS 103	4j-TAR-21-SSUDL-01.C	11/05/21	NEMO (TST6049)	ASTM D1970	4j-TAR-23-SSUDL-07	10/19/23
NEMO (TST6049)	ASTM D226, Type II	4j-TAR-21-SSUDL-01.B	12/21/21	NEMO	Traceability	FBC Cross-List	01/20/20
NEMO (TST6049)	TA/LTA, TAS 103	4j-TAR-21-SSUDL-03.A	06/02/22	NEMO	Traceability	FBC Cross-List 2	03/22/21
NEMO (TST6049)	ASTM D6380	4j-TAR-22-SSUDL-01.A	07/25/22	UL (QUA9625)	QA	Service Confirm (INDIA)	11/22/16
NEMO (TST6049)	ASTM D4798/D1623	4j-TAR-22-SSUDL-03.A	11/15/22	UL (QUA9625)	QA	Service Confirm (PA & TX)	06/16/22
				UL (QUA9625)	QA	Florida BCIS	Current

4. PRODUCT DESCRIPTION:

TABLE 1: EVALUATED UNDERLAYMENTS			
PRODUCT	MATERIAL STANDARD	PLANT(S)	DESCRIPTION
LeakBarrier® FS500 ^{HT}	ASTM D1970	Belton, TX	self-adhering, film-surfaced, SBS modified roof underlayment
LeakBarrier® MS300 Ice and Water Armor	ASTM D1970	Belton, TX Greencastle, PA	self-adhering, glass mat reinforced, mineral surfaced, SBS modified roof underlayment
SRS Distribution TopShield Ice & Water G300	ASTM D1970	Belton, TX Greencastle, PA	self-adhering, glass mat reinforced, mineral surfaced, SBS modified roof underlayment
LeakBarrier® PS200 ^{HT} Ice and Water Armor	FRSA/TRI and TAS 103	Greencastle, PA	self-adhering, glass mat reinforced, fabric surfaced, SBS modified roof underlayment
LeakBarrier® PS200 ^{MU} Ice and Water Armor	ASTM D1970	Greencastle, PA	self-adhering, glass mat reinforced, smooth poly film surfaced, SBS modified roof underlayment
LeakBarrier® NR600 Ultra Ice and Water Armor	FRSA/TRI and TAS 103	Greencastle, PA	self-adhering, polyester-fabric surfaced, SBS modified roof underlayment
#30 ASTM Specification Felt	ASTM D226, Type II	Greencastle, PA	asphalt-saturated organic felt
LeakBarrier® EasyLay®	ASTM D226, Type II	Belton, TX	asphalt-coated polyester fabric roof underlayment
Fiberglass Mineral Surfaced Roll Roofing	ASTM D3909	Greencastle, PA	glass-fiber-reinforced, asphalt-coated, granule surfaced underlayment used as a valley liner
ASTM Organic Mineral Surface Tile Underlayment	ASTM D6380, Class M	Greencastle, PA	asphalt-saturated organic roll roofing sheet
LeakBarrier® EasyLay® UDL 15	ASTM D8257	Gujarat, India	woven-polymeric scrim with a textured fabric on the top surface
SRS Distribution TopShield® EL30	ASTM D8257	Gujarat, India	woven-polymeric scrim with a textured fabric on the top surface
LeakBarrier® EasyLay® UDL Basic	ASTM D8257	Gujarat, India	woven-polymeric scrim with a textured fabric on the top surface

5. LIMITATIONS:

- 5.1 This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance. PEERs are not to be construed as representing any attributes not specifically listed, nor are PEERs to be construed as an endorsement of the subject, or a recommendation for its use. There is no warranty by NEMO ETC, LLC or Robert Nieminen, P.E., express or implied, as to any finding or other matter in this PEER, or as to any product covered by the PEER.
- 5.2 This PEER is not for use in FBC High Velocity Hurricane Zone jurisdictions, as defined in FBC Chapter 2 (Broward and Miami-Dade Counties).
- 5.3 This PEER pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This PEER does not include evaluation of fire classification. Refer to **FBC 1505** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.

5.5 **Tarco Roof Underlayments** may be used with any prepared roof cover where the product is specifically referenced within FBC approval documents. If not listed, a request may be made to the Authority Having Jurisdiction for approval based on this PEER combined with supporting data for the prepared roof covering.

5.6 **Allowable Roof Covers:**

TABLE 2: ROOF COVER OPTIONS						
FBC NON-HVHZ:	1507.2	1507.3		1507.4 & 1507.5	1507.7	1507.8 & 1507.9
UNDERLAYMENT	ASPHALT SHINGLES	CLAY AND CONCRETE TILE		METAL PANELS OR SHINGLES	SLATE OR SLATE-TYPE SHINGLES	WOOD SHINGLES OR SHAKES
		MECHANICAL ATTACH	ADHESIVE- OR MORTAR-SET			
LeakBarrier FS500 ^{HT}	Yes	No	No	Yes	Yes	Yes ⁱ
LeakBarrier MS300	Yes	No	No	No	Yes	Yes ⁱ
TopShield Ice & Water G300	Yes	No	No	No	Yes	Yes ⁱ
LeakBarrier PS200 ^{HT}	Yes	Yes	Yes (Table 2A)	Yes (No copper or zinc)	Yes	Yes ⁱ
LeakBarrier PS200 ^{MU}	Yes	No	No	Yes (No copper or zinc)	Yes	Yes ⁱ
LeakBarrier NR600 Ultra	Yes	Yes	Yes (Table 2A)	Yes (No copper or zinc)	Yes	Yes ⁱ
LeakBarrier EasyLay	Yes	Yes (Base Sheet per Table 4B)	Yes (Base Sheet per Table 4B)	No	Yes	No
LeakBarrier EasyLay UDL 15 or LeakBarrier EasyLay UDL Basic	Yes	Yes (Base Sheet per Table 4B)	Yes (Base Sheet per Table 4B)	Yes	Yes	No
TopShield EL30	Yes	Yes (Base Sheet per Table 4B)	Yes (Base Sheet per Table 4B)	Yes	Yes	No
#30 ASTM Specification Felt	Yes	No	No	Yes	Yes	Yes
Fiberglass Mineral Surfaced Roll Roofing	Yes (Valley Liner)	No	No	No	No	No
ASTM Organic Mineral Surface Tile Underlayment	Yes (Valley Liner)	No	No	No	No	No

5.6.1 **Allowable Tile Adhesives:**

TABLE 2A: ALLOWABLE UNDERLAYMENT / TILE-ADHESIVE COMBINATIONS ⁱⁱ						
UNDERLAYMENT	TILE-ADHESIVE OPTIONS AND FLORIDA PRODUCT APPROVAL					
	DAP GLOBAL		DUPONT	ICP CONSTRUCTION		MORTAR (MEETING FRSA/TRI AND HOLDING CURRENT FPA)
	FL14506		FL22525	FL6332	FL6276	
	STORMBOND	STORMBOND 2	TILE BOND	APOC POLYSET AH-160	APOC POLYSET RTA-1	
LeakBarrier NR600 Ultra	Yes	Yes	Yes	Yes	Yes	No
LeakBarrier PS200 ^{HT}	No	No	Yes	Yes	Yes	No

5.7 Allowable Substrates:

TABLE 3: ALLOWABLE SUBSTRATE OPTIONS FOR ADHERED UNDERLAYMENTS				
UNDERLAYMENT	APPLICATION	SUBSTRATES (DESIGNED TO MEET CODE)		
		TYPE	PRIMER	MATERIAL(S)
LeakBarrier FS500 ^{HT}	self-adhering	Deck / sheathing	(Optional) ASTM D41	Plywood, OSB
		Base Sheet	None	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic
		Flashing / Valley	ASTM D41	aluminum, galvanized steel
LeakBarrier MS300, TopShield Ice & Water G300, LeakBarrier PS200 ^{HT} , LeakBarrier PS200 ^{MU} or LeakBarrier NR600 Ultra	self-adhering	Deck / sheathing	(Optional) ASTM D41	Plywood, OSB
		Deck	ASTM D41	structural concrete
		Base Sheet	None	ASTM D226 Type II felt; ASTM D4869 Type III or IV felt; LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic
		Flashing / Valley	ASTM D41	aluminum, galvanized steel
ASTM Organic Mineral Surface Tile Underlayment	hot asphalt	Deck	ASTM D41	structural concrete
		Base Sheet	None	ASTM D226 Type II felt, ASTM D4601 base sheet

5.8 Attachment Limitations:

5.8.1 For use under mechanically attached NON-TILE prepared roof coverings, attachment shall be in accordance with the manufacturer's installation instructions, but – for mechanically attached underlayments or base sheets - not less than **FBC 1507.1.1** or **R905.1.1**.

5.8.2 Wind Resistance for Underlayment Systems in Tile Roof Applications:

The following wind uplift limitations apply to tile underlayment systems. The Maximum Design Pressure ('MDP') is the result of testing for wind load resistance based on allowable wind loads, and reflects the ultimate passing pressure divided by 2 (the 2 to 1 margin of safety per **FBC 1504.9** has already been applied).

5.8.2.1 Direct-to-Deck:

The maximum design pressure for the selected assembly shall meet or exceed that required under FRSA/TRI Florida Manual, 7th Edition, Appendix A or the critical (highest) design pressure determined in accordance with **FBC 1609** or **FBC Residential Chapter 3**.

TABLE 4A: ALLOWABLE DESIGN PRESSURES, DIRECT-TO-DECK UNDERLAYMENT IN TILE ROOF APPLICATIONS						
SYSTEM No.	DECK	PRIMER	JOINT TREATMENT	BASE PLY	CAP PLY	MDP (PSF)
UDL-1.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) ASTM D41	None	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} or LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-75.0
UDL-2.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) ASTM D41	None	None	LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-105.0

**TABLE 4A: ALLOWABLE DESIGN PRESSURES,
DIRECT-TO-DECK UNDERLAYMENT IN TILE ROOF APPLICATIONS**

SYSTEM NO.	DECK	PRIMER	JOINT TREATMENT	BASE PLY	CAP PLY	MDP (PSF)
UDL-3.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) ASTM D41	Min. 4-inch wide strips of LeakBarrier PS200 ^{MU}	None	LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-120.0
UDL-4.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	(Optional) ASTM D41	Min. 4-inch wide strips of LeakBarrier PS200 ^{MU} or LeakBarrier EasyBase	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-120.0
UDL-5.	Structural concrete	(Optional) ASTM D41	N/A	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} or LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-217.5
UDL-6.	Structural concrete	ASTM D41	N/A	None	LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-340.0

5.8.2.2 Mechanically-Attached Base Sheet:

The maximum design pressure for the selected assembly shall meet or exceed that required under **FRSA/TRI Manual 7th Edition**, Appendix A or the critical (highest) design pressure determined in accordance with **FBC 1609** or **FBC Residential Chapter 3**.

Alternatively, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 design pressure determined in accordance with **FBC 1609** or **FBC Residential Chapter 3**. Elevated pressure zones shall employ an attachment density by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI](#) WD1, [FM Loss Prevention Data Sheet](#) 1-29 or [Roofing Application Standard](#) RAS 117 or RAS 137. Assemblies marked with an asterisk* carry the limitations set forth in Section 2.2.10.1 of [FM Loss Prevention Data Sheet](#) 1-29 for enhancements.

**TABLE 4B: ALLOWABLE DESIGN PRESSURES,
2-PLY UNDERLAYMENT SYSTEMS IN TILE ROOF APPLICATIONS**

SYSTEM NO.	DECK	BASE SHEET		BASE PLY	CAP PLY	MDP (PSF)
		TYPE	ATTACH			
UDL-7.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 8-inch o.c. at three (3) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-45.0*
UDL-8.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 8-inch o.c. at three (3) equally spaced, staggered center rows. ASTM D41 primer at tin caps.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-45.0*

**TABLE 4B: ALLOWABLE DESIGN PRESSURES,
2-PLY UNDERLAYMENT SYSTEMS IN TILE ROOF APPLICATIONS**

SYSTEM NO.	DECK	BASE SHEET		BASE PLY	CAP PLY	MDP (PSF)
		TYPE	ATTACH			
UDL-9.	Plywood , APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	LeakBarrier EasyLay	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 7-inch o.c. at the 4-inch wide side laps and 7-inch o.c. at three (3) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-60.0
UDL-10.	Plywood , APA rated sheathing, 40/20, Exposure 1, PS1, 19/32 category	LeakBarrier EasyLay	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 7-inch o.c. at the 4-inch wide side laps and 7-inch o.c. at three (3) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back-nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps spaced 12-inch o.c. within the self-adhering side laps	-60.0
UDL-11.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at four (4) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-60.0
UDL-12.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 6-inch o.c. at the 4-inch wide side laps and 6-inch o.c. at four (4) equally spaced, staggered center rows. ASTM D41 primer at tin caps.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back-nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps spaced 12-inch o.c. within the self-adhering side laps	-60.0
UDL-13.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay	Simplex MAXX Cap Fasteners (NOA 18-1227.05); 8-inch o.c. at the 4-inch wide side laps and 8-inch o.c. at four (4) equally spaced staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-82.5
UDL-14.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay	Simplex MAXX Cap Fasteners (NOA 18-1227.05); 8-inch o.c. at the 4-inch wide side laps and 8-inch o.c. at four (4) equally spaced staggered center rows.	LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back-nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps spaced 12-inch o.c. within the self-adhering side laps	-82.5
UDL-15.	Plywood , APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 4-inch o.c. at the 4-inch wide side laps and 4-inch o.c. at four (4) equally spaced, staggered center rows.	(Optional) LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier PS200 ^{HT} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	-120.0

TABLE 4B: ALLOWABLE DESIGN PRESSURES, 2-PLY UNDERLAYMENT SYSTEMS IN TILE ROOF APPLICATIONS						
SYSTEM NO.	DECK	BASE SHEET		BASE PLY	CAP PLY	MDP (PSF)
		TYPE	ATTACH			
UDL-16.	Plywood, APA rated sheathing, 32/16, Exposure 1, PS1, 15/32 category	LeakBarrier EasyLay	12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps; 4-inch o.c. at the 4-inch wide side laps and 4-inch o.c. at four (4) equally spaced, staggered center rows.	LeakBarrier PS200 ^{MU} , self-adhered and back-nailed in accordance with Tarco installation instructions, max. 12-inch o.c.	LeakBarrier NR600 Ultra, self-adhered and back nailed using 12 ga. x 1.25-inch long x 3/8-inch head diameter annular ring shank roofing nails and 1-5/8-inch diameter tin caps spaced 12-inch o.c. within the self-adhering side laps	-120.0

5.9 **Exposure Limitations:**

TABLE 5: EXPOSURE LIMITATIONS		
UNDERLAYMENT	PREPARED ROOF COVER INSTALLATION TYPE	MAXIMUM EXPOSURE (DAYS)
#30 ASTM Specification Felt	Mechanically attached	1
LeakBarrier FS500 ^{HT} , LeakBarrier MS300, PS200 ^{MU} or TopShield Ice & Water G300	Mechanically attached	30
LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic	Mechanically attached	90
LeakBarrier EasyLay	Mechanically attached	180
LeakBarrier PS200 ^{HT} or LeakBarrier NR600 Ultra	Any type (per Table 2)	180
ASTM Organic Mineral Surface Tile Underlayment	Any type (per Table 2)	180

5.10 **Tile Slippage Limitations:** When loading roof tiles on the underlayment, the maximum roof pitch shall be as follows. These pitch limitations can only be exceeded by using battens or loading boards during loading of the roof tiles.

TABLE 6: TILE SLIPPAGE LIMITATIONS FOR DIRECT-DECK TILE INSTALLATIONS			
UNDERLAYMENT*	TILE PROFILE	STAGING METHOD	MAXIMUM STAGING PITCH
LeakBarrier PS200 ^{HT}	Flat or Lugged	6-tile stack (4 over 2)	6:12
LeakBarrier NR600 Ultra	Flat or Lugged	10-tile stack	6:12
2-ply system; LeakBarrier PS200 ^{MU} followed by LeakBarrier NR600 Ultra	Flat or Lugged	10-tile stack	6:12

Notes: *Tarco specifies a minimum 48 cure-time after the installation of self-adhering membranes and before loading of roofing tiles.

5.11 All components in the roof assembly shall have quality assurance audit in accordance with **F.A.C. Rule 61G20-3**. Refer to the Product Approval of the component manufacturer for components mentioned herein that are produced by a Product Manufacturer other than the report holder on [Page 1](#) of this PEER.

6. INSTALLATION:

6.1 **Tarco Roof Underlayments** shall be installed in accordance with **Tarco Roofing** installation instructions subject to the [Limitations of Use](#) herein and the specifics noted below.

6.1.1 Consult Tarco requirements for back-nailing at pitch of 2:12 or greater.

6.2 Re-fasten any loose decking panels, and check for protruding nail heads. Sweep the substrate thoroughly to remove any dust and debris prior to application, and prime the substrate (if applicable).

6.3 #30 ASTM Specification Felt:

6.3.1 Non-Tile Applications:

Shall be installed in compliance with requirements for an approved mechanically attached underlayment (ASTM D226, Type II) in **FBC Table 1507.1.1.1** or **FBC Residential Table R905.1.1.1** for the type of prepared roof covering to be installed, and the manufacturer's installation instructions. FBC requirements take precedence over the manufacturer's installation instructions.

6.4 LeakBarrier EasyLay:

6.4.1 Non-Tile Applications:

Shall be installed in compliance with requirements for an approved mechanically attached underlayment (ASTM D226, Type II) in **FBC Table 1507.1.1.1** or **FBC Residential Table R905.1.1.1** for the type of prepared roof covering to be installed, and the manufacturer's installation instructions. FBC requirements take precedence over the manufacturer's installation instructions.

6.4.2 Tile Applications:

LeakBarrier EasyLay is limited to use as a mechanically attached base sheet in the "TWO-PLY SYSTEM" from **FRSA/TRI Florida Manual, 7th Edition**.

LeakBarrier EasyLay shall be installed in compliance with the selected assembly from [Table 4B](#), which take precedence over the manufacturer's installation instructions.

6.5 LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic:

6.5.1 Non-Tile Applications:

Shall be installed in compliance with requirements for a synthetic underlayment (ASTM D8257) in **FBC 1507.1.1.1** or **FBC Residential R905.1.1.1** for the type of prepared roof covering to be installed, and the manufacturer's installation instructions.

6.5.2 Tile Applications:

LeakBarrier EasyLay UDL 15, TopShield EL30 and LeakBarrier EasyLay UDL Basic are limited to use as a mechanically attached base sheet in the "TWO-PLY SYSTEM" from **FRSA/TRI Florida Manual, 7th Edition**.

LeakBarrier EasyLay UDL 15, TopShield EL30 and LeakBarrier EasyLay UDL Basic shall be installed in compliance with the selected assembly from [Table 4B](#), which take precedence over the manufacturer's installation instructions.

6.6 LeakBarrier FS500^{HT}, LeakBarrier® MS300, LeakBarrier® PS200^{MU} or TopShield Ice & Water G300:

6.6.1 Shall be installed in compliance with requirements for an approved self-adhering underlayment (ASTM D1970) in **FBC 1507.1.1.1** or **FBC Residential R905.1.1.1** for the type of prepared roof covering to be installed, and the manufacturer's installation instructions.

When installed over a mechanically attached base sheet of FBC Approved ASTM D226 Type II felt, ASTM D4869, Type III or IV felt, LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic, the base sheet shall be fastened in accordance with **FBC 1507.1.1** or **R905.1.1**.

6.7 LeakBarrier® PS200^{HT} or LeakBarrier® NR600 Ultra:

6.7.1 Non-Tile Applications:

Shall be installed in compliance with requirements for an approved self-adhering underlayment (ASTM D1970) in **FBC 1507.1.1.1** or **FBC Residential R905.1.1.1** for the type of prepared roof covering to be installed, and the manufacturer's installation instructions.

When installed over a mechanically attached base sheet of FBC Approved ASTM D226 Type II felt or ASTM D4869, Type III or IV felt, LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic, the base sheet shall be fastened in accordance with **FBC 1507.1.1** or **R905.1.1**.

6.7.2 Tile Applications:

Shall be installed in compliance with requirements for a Self-Adhered Membrane in the **FRSA/TRI Florida Manual, 7th Edition**, and the manufacturer's installation instructions.

Refer to [Section 5.8](#) for attachment limitations.

Refer to [Table 6](#) for tile staging limitations.

6.7.2 Multi-Ply Underlayment Systems:

LeakBarrier® PS200^{MU} followed by LeakBarrier® NR600 Ultra is allowable for use under mechanically attached prepared roof systems and adhesive-set tile roof systems. Limits of use are those associated with the top-layer material. This is not a requirement, but is allowable if a multi-ply underlayment system is desired.

6.8 ASTM Organic Mineral Surface Tile Underlayment or Fiberglass Mineral Surface Roll Roofing:

- 6.8.1 ASTM Organic Mineral Surface Tile Underlayment or Fiberglass Mineral Surface Roll Roofing may be used as a valley liner in accordance with **FBC 1507.2.9.2** or **FBC Residential R905.2.8.2**. Installation shall be in accordance with the manufacturer's instructions.

7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction in order to properly evaluate the installation of this product.

8. MANUFACTURING PLANTS:

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

9. QUALITY ASSURANCE ENTITY:

[UL LLC – QUA9625](#); (360) 817-5512; bsai.inspections@ul.com

- END OF PEER -

ⁱ Used as min. 3 ¼-inch wide joint-strips per **FBC 1507.1.1.1(2)** / **FBC R905.1.1.1(2)** or installed in full-coverage atop ASTM D226, Type II felt, ASTM D4869 Type III or IV felt, LeakBarrier EasyLay, LeakBarrier EasyLay UDL 15, TopShield EL30 or LeakBarrier EasyLay UDL Basic mechanically attached in accordance with **FBC Table 1507.1.1.1** or **FBC Residential Table R905.1.1.1**

ⁱⁱ Refer to Tile Manufacturer's or Adhesive Manufacturer's Florida Product Approval for Overturning Moment Resistance Performance